




- ALCOSAN WWTTP**
- ALCOSAN Outfalls**
- Sanitary Sewer Outfall (Appendix A)
 - Combined Sewer Outfall (Appendix B)
- Municipal Outfalls**
- Combined Sewer Outfall
 - Sanitary Sewer Outfall
- ALCOSAN Pipes**
- Force Main
 - Inter-Municipal Interceptor
 - Shallow-cut Interceptor
 - Subaqueous Interceptor
 - Deep Tunnel Interceptor
- Planning Basins**
- Chartiers Creek
 - Lower Ohio River/Girty's Run
 - Main Rivers
 - Saw Mill Run
 - Turtle Creek/Thompson Run
 - Upper Allegheny/Pine Creek
 - Upper Monongahela
 - Rivers
 - Hydrologic Features
- 303d Non Attaining 2023 Potable Water Supply***
- 303d Attaining 2023 Potable Water Supply***
- Municipal Boundaries**
- ALCOSAN Service Area**

*Data Source:
Office of Water Management
Bureau of Water Supply & Wastewater Management
Water Quality Assessment and Standards Division
Pennsylvania Department of Environmental Protection
(Data downloaded on 2/16/2022)

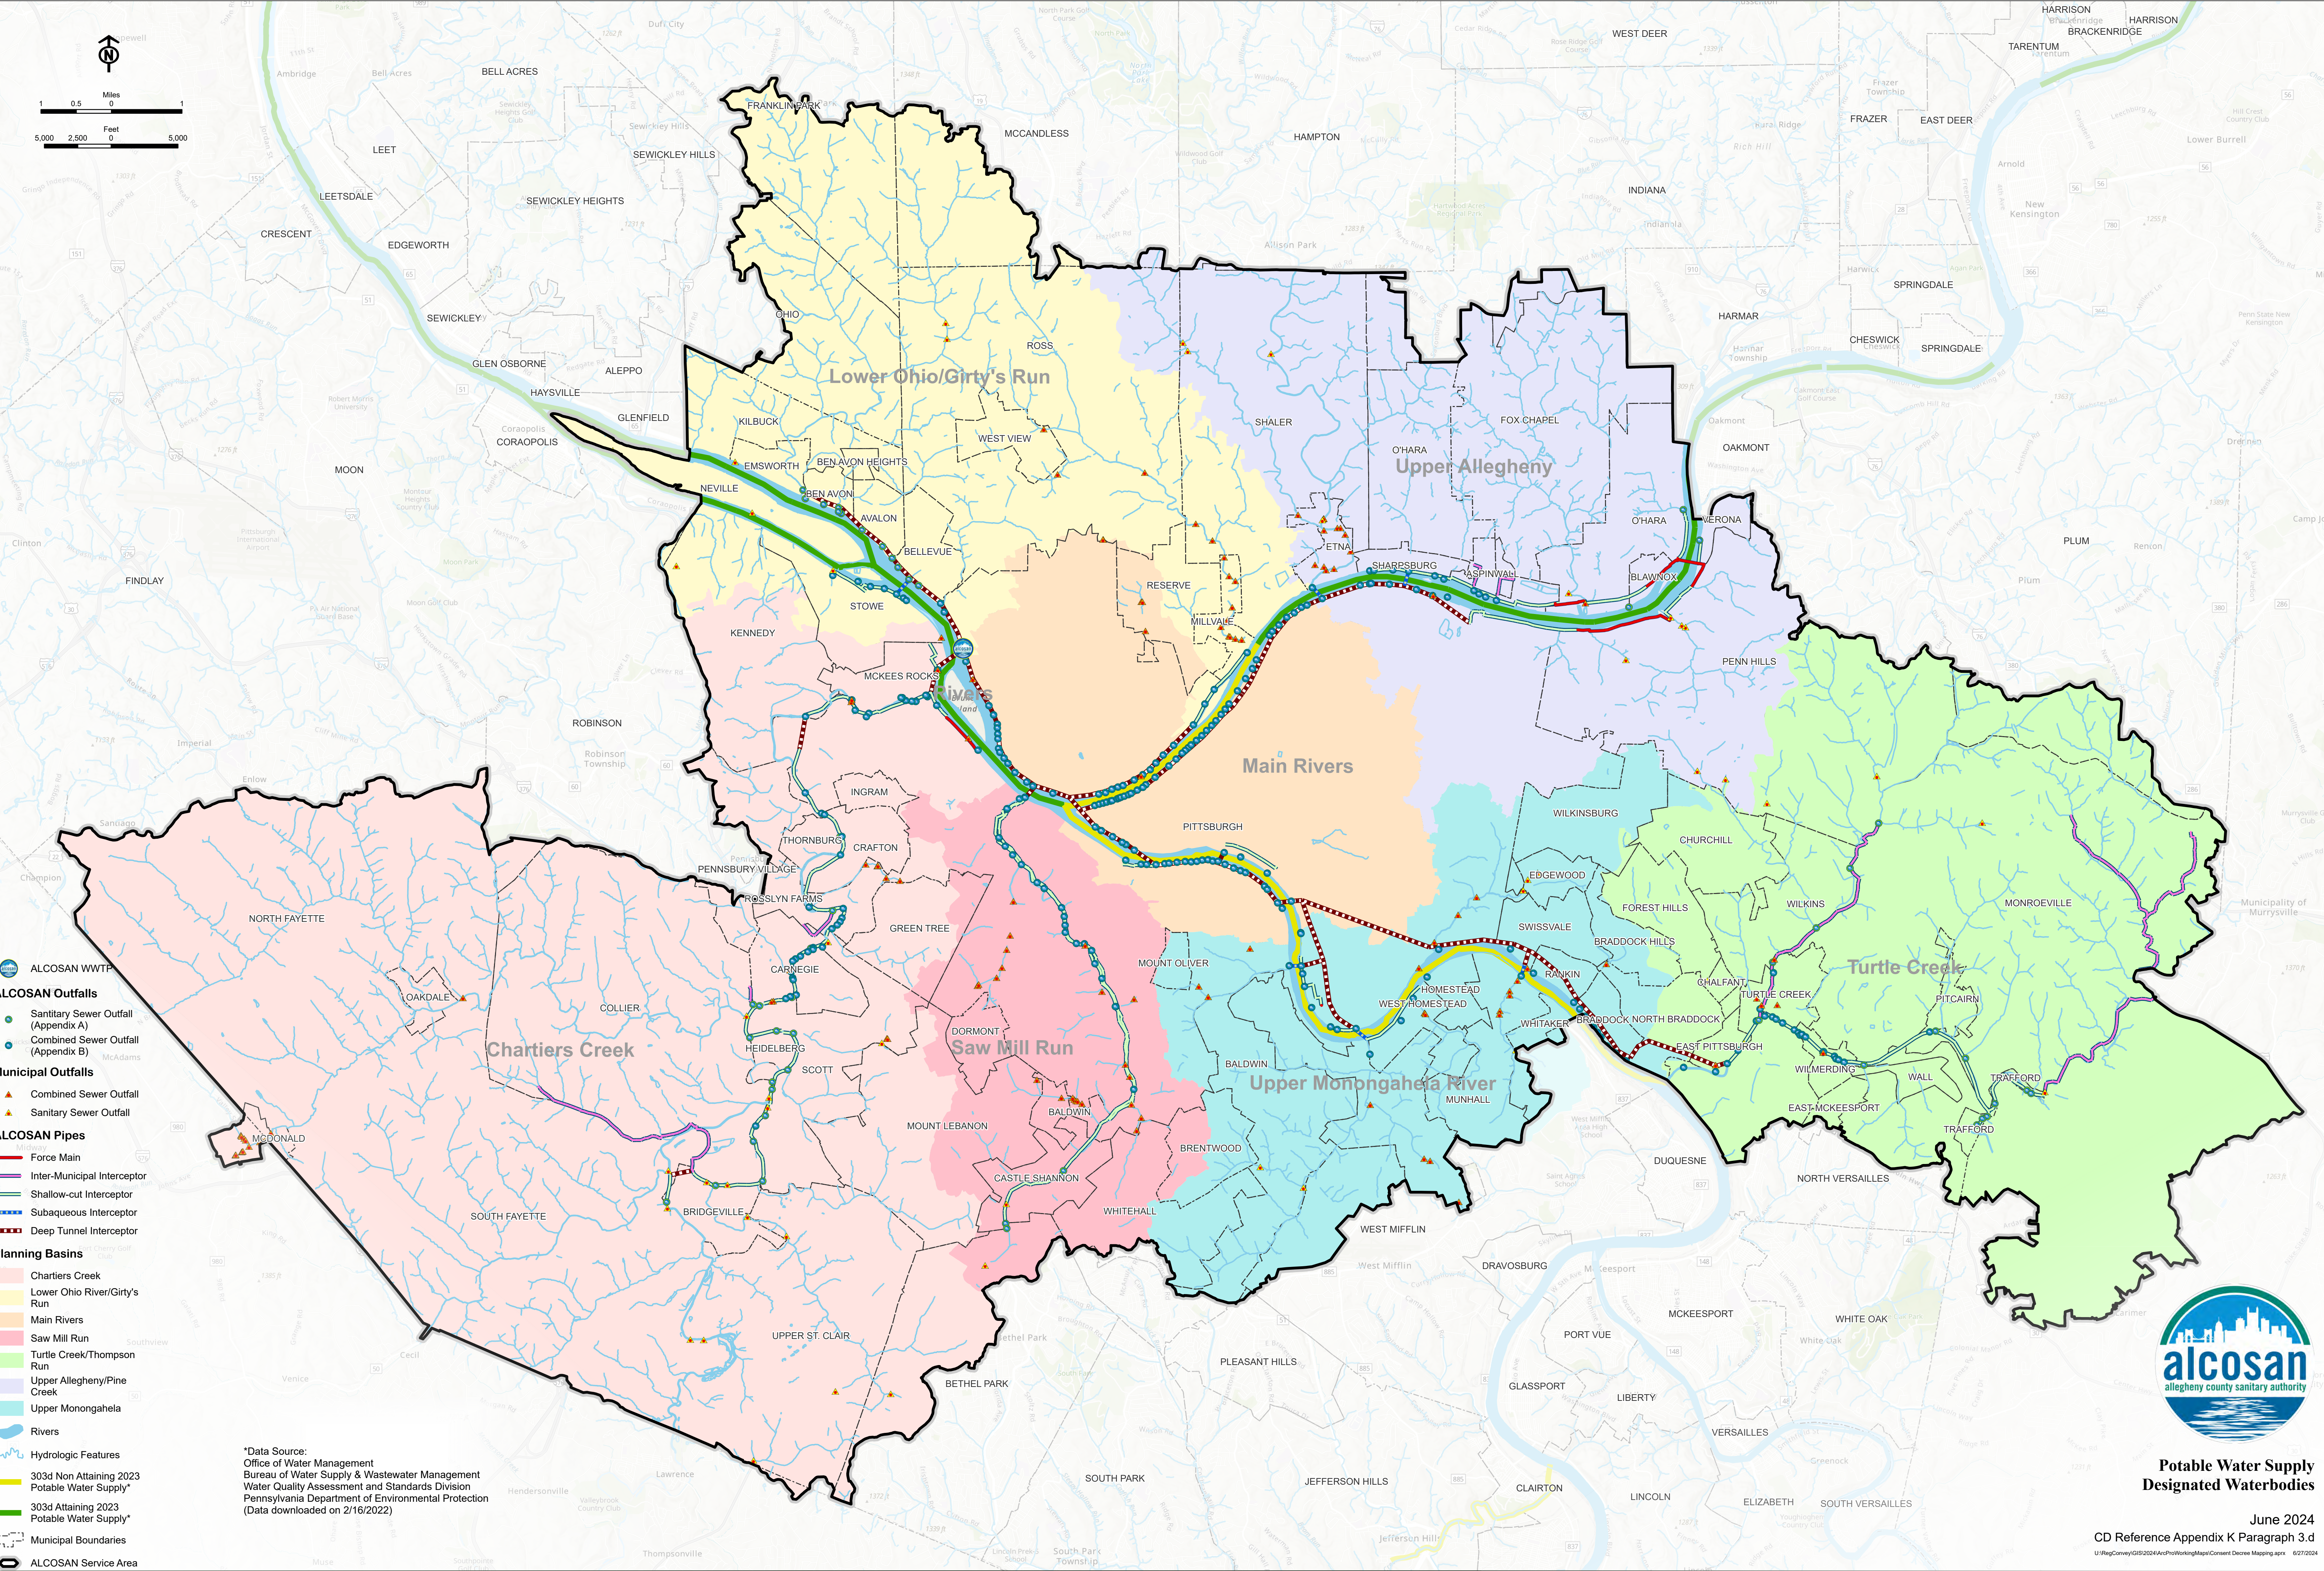

**Potable Water Supply
Designated Waterbodies**